



**Technical and Test Institute
for Construction Prague**

Prosecká 811/76a
190 00 Prague
Czech Republic
eota@tzus.cz



Member of



www.eota.eu

European Technical Assessment

ETA 13/0448 of 16/05/2018

Technical Assessment Body issuing the ETA: Technical and Test Institute
for Construction Prague

Trade name of the construction product

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

**Product family to which the construction
product belongs**

Product area code: 33
Bonded injection type anchor for use
in uncracked concrete

Manufacturer

Lusan Fijaciones y Anclajes, S.L.
Pol. Plà de la Bruguera, C/ Solsonès,
66 082111 Castellar del Vallès, Barcelona,
Spain

Manufacturing plant

Plant 1

**This European Technical Assessment
contains**

13 pages including 10 Annexes which form
an integral part of this assessment

**This European Technical Assessment is
issued in accordance with regulation
(EU) No 305/2011, on the basis of**

EAD 330499-00-0601

This version replaces

ETA 13/0448 issued on 30/05/2013

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full (excepted the confidential Annex(es) referred to above). However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body - Technical and Test Institute for Construction Prague. Any partial reproduction has to be identified as such

1. Technical description of the product

The LUSAN POLIESTER SIN ESTIRENO with steel elements is bonded anchor (injection type).

Steel elements can be galvanized or stainless steel.

Steel element is placed into a drilled hole filled with injection mortar. The steel element is anchored via the bond between metal part, injection mortar and concrete. The anchor is intended to be used with embedment depth from 8 diameters to 12 diameters.

The illustration and the description of the product are given in Annex A.

2. Specification of the intended use in accordance with the applicable EAD

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The provisions made in this European Technical Assessment are based on an assumed working life of the anchor of 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the products in relation to the expected economically reasonable working life of the works.

3. Performance of the product and references to the methods used for its assessment

3.1 Mechanical resistance and stability (BWR 1)

| Essential characteristic | Performance |
|--|--------------|
| Resistance to steel failure (tension) | See Annex C1 |
| Resistance to combined pull-out and concrete failure | See Annex C1 |
| Resistance to concrete cone failure | See Annex C1 |
| Edge distance to prevent splitting under load | See Annex C1 |
| Robustness | See Annex C1 |
| Maximum setting torque moment | See Annex B4 |
| Minimum edge distance and spacing | See Annex B4 |
| Resistance to steel failure (shear) | See Annex C2 |
| Resistance to pry-out failure | See Annex C2 |
| Resistance to concrete edge failure | See Annex C2 |
| Displacements under short term and long term loading | See Annex C3 |
| Durability of metal parts | See Annex A3 |

3.2 Hygiene, health and environment (BWR 3)

No performance determined.

3.3 General aspects relating to fitness for use

Durability and serviceability are only ensured if the specifications of intended use according to Annex B 1 are kept.

4. Assessment and verification of constancy of performance (AVCP) system applied with reference to its legal base

According to the Decision 96/582/EC of the European Commission¹ the system of assessment verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table apply.

¹ Official Journal of the European Communities L 254 of 08.10.1996

| Product | Intended use | Level or class | System |
|-----------------------------------|---|-----------------------|---------------|
| Metal anchors for use in concrete | For fixing and/or supporting to concrete, structural elements (which contributes to the stability of the works) or heavy units. | - | 1 |

5. Technical details necessary for the implementation of the AVCP system, as provided in the applicable EAD

5.1 Tasks of the manufacturer

The manufacturer may only use raw materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the control plan which is a part of the technical documentation of this European Technical Assessment. The control plan is laid down in the context of the factory production control system operated by the manufacturer and deposited at Technický a zkušební ústav stavební Praha, s.p.² The results of factory production control shall be recorded and evaluated in accordance with the provisions of the control plan.

5.2 Tasks of the notified bodies

The notified body shall retain the essential points of its actions referred to above and state the results obtained and conclusions drawn in a written report.

The notified certification body involved by the manufacturer shall issue an certificate of constancy of performance of the product stating the conformity with the provisions of this European Technical Assessment.

In cases where the provisions of the European Technical Assessment and its control plan are no longer fulfilled the notified body shall withdraw the certificate of constancy of performance and inform Technical and Test Institute for Construction Prague without delay.

Issued in Prague on 16.05.2018


By

Ing. Mária Schaan

Head of the Technical Assessment Body

² The control plan is a confidential part of the documentation of the European Technical Assessment, but not published together with the ETA and only handed over to the approved body involved in the procedure of AVCP.

Threaded rod

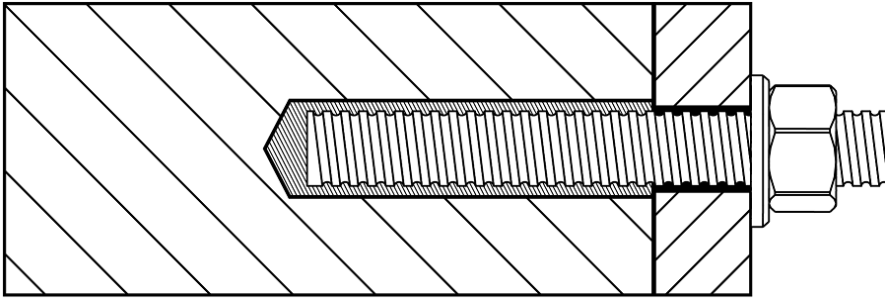

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Product description
Installed conditions

Annex A 1

Coaxial cartridge


LUSAN POLIESTER SIN ESTIRENO 150 ml
 380 ml
 400 ml
 410 ml

**Side by side cartridge**

LUSAN POLIESTER SIN ESTIRENO 350 ml
 825 ml

**Two part foil in a single piston component cartridge**

LUSAN POLIESTER SIN ESTIRENO 150 ml
 170 ml
 300 ml
 550 ml
 850 ml

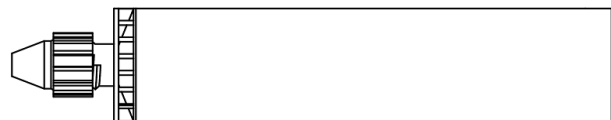**Peeler cartridge**


LUSAN POLIESTER SIN ESTIRENO 280 ml

**Marking of the mortar cartridges**

Identifying mark of the producer, Trade name, Charge code number, Storage life, Curing and processing time

Mixing nozzle


CMN



CMLR



KR for use with 850




LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Product description
 Injection system

Annex A 2

Threaded rod M8, M10, M12, M16, M20, M24

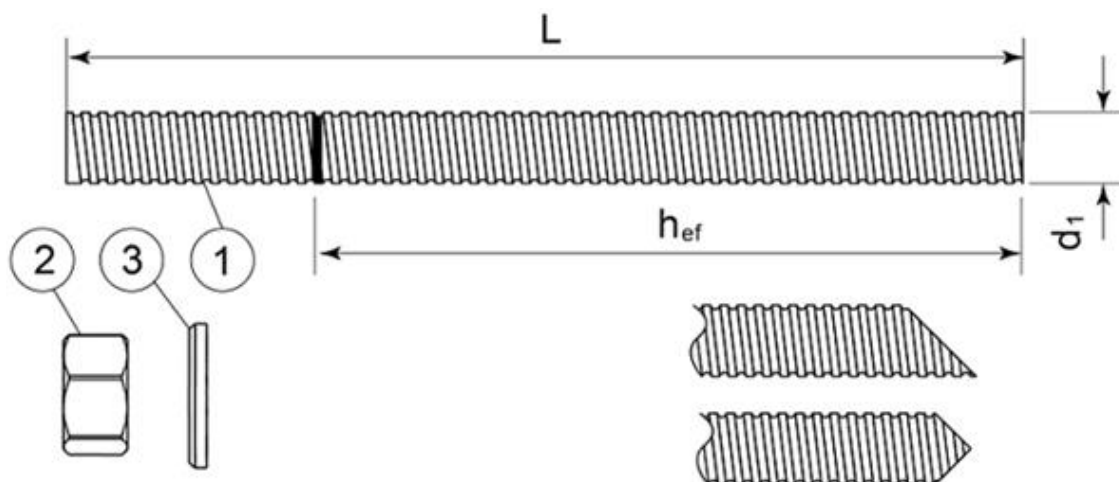

Standard commercial threaded rod with marked embedment depth

| Part | Designation | Material |
|---|--|--|
| Steel, zinc plated $\geq 5 \mu\text{m}$ acc. to EN ISO 4042 or Steel, Hot-dip galvanized $\geq 40 \mu\text{m}$ acc. to EN ISO 1461 and EN ISO 10684 or Steel, zinc diffusion coating $\geq 15 \mu\text{m}$ acc. to EN 13811 | | |
| 1 | Anchor rod | Steel, EN 10087 or EN 10263 Property class 5.8, 8.8, 10.9* EN ISO 898-1 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod, EN 20898-2 |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |
| Stainless steel | | |
| 1 | Anchor rod | Material: A2-70, A4-70, A4-80, EN ISO 3506 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |
| High corrosion resistant steel | | |
| 1 | Anchor rod | Material: 1.4529, 1.4565, EN 10088-1 |
| 2 | Hexagon nut EN ISO 4032 | According to threaded rod |
| 3 | Washer EN ISO 887, EN ISO 7089, EN ISO 7093 or EN ISO 7094 | According to threaded rod |

*Galvanized rod of high strength are sensitive to hydrogen induced brittle failure

**LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor**

Product description
Threaded rod and materials

Annex A 3

Specifications of intended use

Anchorage subject to:

- Static and quasi-static load.

Base materials

- Uncracked concrete.
- Reinforced or unreinforced normal weight concrete of strength class C20/25 at minimum and C50/60 at maximum according EN 206-1:2000-12.

Temperature range:

- -40°C to +80°C (max. short. term temperature +80°C and max. long term temperature +50°C)

Use conditions (Environmental conditions)

- (X1) Structures subject to dry internal conditions (zinc coated steel, stainless steel, high corrosion resistance steel).
- (X2) Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel A4, high corrosion resistant steel).
- (X3) Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel).

Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

Concrete conditions:

- I1 – installation in dry or wet (water saturated) concrete or flooded hole.
- I2 – installation in water-filled (not sea water) and use in service in dry or wet concrete

Design:

- The anchorages are designed in accordance with the EN 1992-4 or EOTA Technical Report TR 055 under the responsibility of an engineer experienced in anchorages and concrete work.
- Verifiable calculation notes and drawings are prepared taking account of the loads to be anchored. The position of the anchor is indicated on the design drawings.

Installation:

- Hole drilling by hammer drill mode.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site.

Installation direction:


- D3 – downward and horizontal and upwards (e.g. overhead) installation

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Intended use
Specifications


Annex B 1

Applicator gun

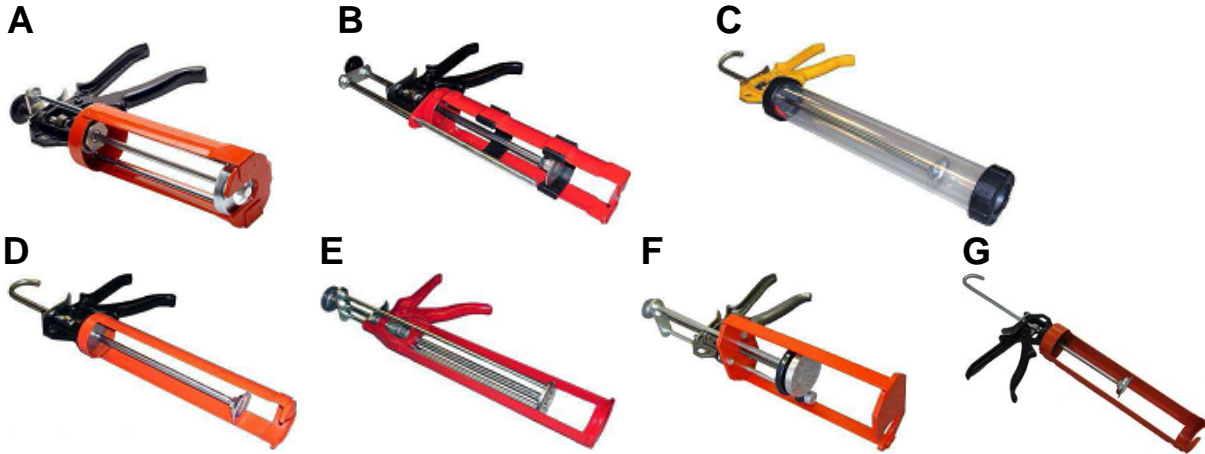

| Applicator gun | A | B | C | D | E | F | G |
|----------------|------------------------------------|-----------------------|---|---|------------------|-----------------------|-----------------------|
| Cartridge | Coaxial 380ml 400ml 410ml | Side by side 350ml | Foil capsule 150ml 300ml 550ml | Foil capsule 150ml 300ml Peeler 280ml | Coaxial 150ml | Side by side 825ml | Foil capsule 850ml |

Cleaning brush

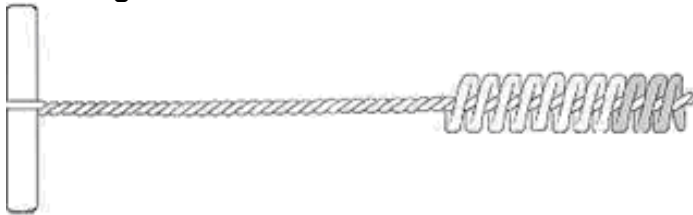


**LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor**

Intended use
Applicator guns
Cleaning brush

Annex B 2






Installation procedure

1. Drill the hole to the correct diameter and depth. This can be done with either a rotary percussion or rotary hammer drilling machine depending upon the substrate.




2. Thoroughly clean the hole in the following sequence using the brush with the required extensions and a blow pump.

Blow Clean x2.
Brush Clean x2.
Blow Clean x2.
Brush Clean x2.
Blow Clean x2.




If the hole collects water after the initial cleaning this water must be removed before injecting the resin.

3. Select the appropriate static mixer nozzle for the installation, open the cartridge/foil and screw onto the mouth of the cartridge. Insert the cartridge into the correct applicator gun.
4. Extrude the first part of the cartridge to waste until an even colour has been achieved without streaking in the resin.

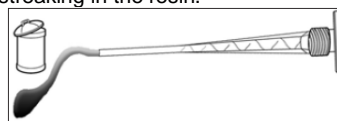

5. If necessary, cut the extension tube to the depth of the hole and push onto the end of the mixer nozzle, and (for threaded bar 16mm dia. or more) fit the correct resin stopper to the other end. Attach extension tubing and resin stopper.

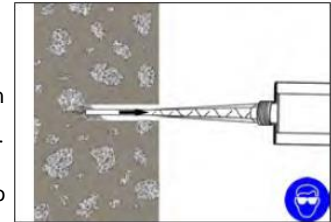


6. Insert the mixer nozzle (resin stopper / extension tube if applicable) to the bottom of the hole. Begin to extrude the resin and slowly withdraw the mixer nozzle from the hole ensuring that there are no air voids as the mixer nozzle is withdrawn. Fill the hole to approximately $\frac{1}{2}$ to $\frac{3}{4}$ full and remove the mixer nozzle completely.

7. Insert the clean threaded bar, free from oil or other release agents, to the bottom of the hole using a back and forth twisting motion ensuring all the threads are thoroughly coated. Adjust to the correct position within the stated working time.




8. Any excess resin should be expelled from the hole evenly around the steel element showing that the hole is full. This excess resin should be removed from around the mouth of the hole before it sets.

9. Leave the anchor to cure. Do not disturb the anchor until the appropriate loading/curing time has elapsed depending on the substrate conditions and ambient temperature.

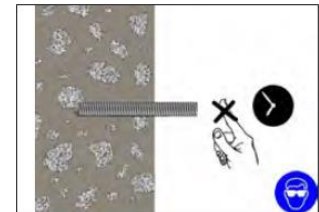

10. Attach the fixture and tighten the nut to the recommended torque.

Do not overtighten.

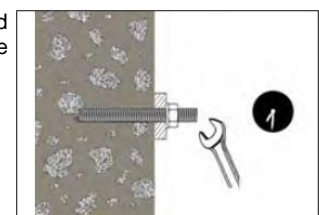

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Intended use
 Installation procedure

Annex B 3

Table B1: Installation parameter

| Size | | | M8 | M10 | M12 | M16 | M20 | M24 |
|--------------------------------------|-------------------|------|--|-----|-----|-----|-----------------|-----|
| Nominal drill hole diameter | $\varnothing d_0$ | [mm] | 10 | 12 | 14 | 18 | 22 | 26 |
| Diameter of cleaning brush | d_b | [mm] | 14 | 14 | 20 | 20 | 29 | 29 |
| Torque moment | $\max T_{fix}$ | [Nm] | 10 | 20 | 40 | 80 | 150 | 200 |
| Depth of drill hole for $h_{ef,min}$ | $h_0 = h_{ef}$ | [mm] | 64 | 80 | 96 | 128 | 160 | 192 |
| Depth of drill hole for $h_{ef,max}$ | $h_0 = h_{ef}$ | [mm] | 96 | 120 | 144 | 192 | 240 | 288 |
| Minimum edge distance | c_{min} | [mm] | 35 | 40 | 50 | 65 | 80 | 96 |
| Minimum spacing | s_{min} | [mm] | 35 | 40 | 50 | 65 | 80 | 96 |
| Minimum thickness of member | h_{min} | [mm] | $h_{ef} + 30 \text{ mm} \geq 100 \text{ mm}$ | | | | $h_{ef} + 2d_0$ | |

Table B2: Cleaning

| All diameters |
|----------------|
| - 2 x blowing |
| - 2 x brushing |
| - 2 x blowing |
| - 2 x brushing |
| - 2 x blowing |

Table B3.1: Minimum curing time

| Resin cartridge temperature [°C] | T Work [mins] | Base material Temperature [°C] | T Load [mins] |
|-------------------------------------|------------------|-----------------------------------|------------------|
| min +5 | 18 | min +5 | 145 |
| +5 to +10 | 10 | +5 to +10 | |
| +10 to +20 | 6 | +10 to +20 | 85 |
| +20 to +25 | 5 | +20 to +25 | 50 |
| +25 to +30 | 4 | +25 to +30 | 40 |
| +30 | | +30 | 35 |

T work is typical gel time at highest temperature

T load is set at the lowest temperature

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Intended use
Installation parameters
Curing time

Annex B 4

Table C1: Design method EN 1992-4
Characteristic values of resistance to tension load

| Steel failure – Characteristic resistance | | | | | | | | | |
|--|---------------|------|--|-----------|------------|------------|------------|------------|------------|
| Size | | | | M8 | M10 | M12 | M16 | M20 | M24 |
| Steel grade 5.8 | $N_{Rk,s}$ | [kN] | | 18 | 29 | 42 | 79 | 123 | 177 |
| Partial safety factor | γ_{Ms} | [-] | | 1,5 | | | | | |
| Steel grade 8.8 | $N_{Rk,s}$ | [kN] | | 29 | 46 | 67 | 126 | 196 | 282 |
| Partial safety factor | γ_{Ms} | [-] | | 1,5 | | | | | |
| Steel grade 10.9 | $N_{Rk,s}$ | [kN] | | 37 | 58 | 84 | 157 | 245 | 353 |
| Partial safety factor | γ_{Ms} | [-] | | 1,4 | | | | | |
| Stainless steel grade A2-70, A4-70 | $N_{Rk,s}$ | [kN] | | 26 | 41 | 59 | 110 | 172 | 247 |
| Partial safety factor | γ_{Ms} | [-] | | 1,9 | | | | | |
| Stainless steel grade A4-80 | $N_{Rk,s}$ | [kN] | | 29 | 46 | 67 | 126 | 196 | 282 |
| Partial safety factor | γ_{Ms} | [-] | | 1,6 | | | | | |
| Stainless steel grade 1.4529 | $N_{Rk,s}$ | [kN] | | 26 | 41 | 59 | 110 | 172 | 247 |
| Partial safety factor | γ_{Ms} | [-] | | 1,5 | | | | | |
| Stainless steel grade 1.4565 | $N_{Rk,s}$ | [kN] | | 26 | 41 | 59 | 110 | 172 | 247 |
| Partial safety factor | γ_{Ms} | [-] | | 1,9 | | | | | |

| Combined pullout and concrete cone failure in uncracked concrete C20/25 | | | | | | | | | |
|--|--|----------------------|-----|-----------|------------|------------|------------|------------|------------|
| Size | | | | M8 | M10 | M12 | M16 | M20 | M24 |
| Characteristic bond resistance in uncracked concrete | | | | | | | | | |
| Dry/wet concrete and flooded hole | $\tau_{Rk,ucr}$ | [N/mm ²] | | 8 | 7 | 8 | 7,5 | 6,5 | 6,5 |
| Installation safety factor | $\gamma_2^{(1)} = \gamma_{inst}^{(2)}$ | [-] | | 1,2 | | | | | |
| Factor for concrete | C30/37 | ψ_c | [-] | 1,12 | | | | | |
| | C35/45 | | | 1,19 | | | | | |
| | C50/60 | | | 1,30 | | | | | |

| Concrete cone failure | | | | | | | | | |
|----------------------------------|-------------------|------|--|--------------|--|--|--|--|--|
| Factor for concrete cone failure | $k_1^{(1)}$ | [-] | | 10,1 | | | | | |
| | $k_{ucr,N}^{(2)}$ | | | 11 | | | | | |
| Edge distance | $c_{cr,N}$ | [mm] | | 1,5 h_{ef} | | | | | |

| Splitting failure | | | | | | | | | |
|--------------------------|----------------|------|--|--------------|------------|------------|--------------|------------|------------|
| Size | | | | M8 | M10 | M12 | M16 | M20 | M24 |
| Edge distance | $c_{cr,sp}$ | [mm] | | 2,0 h_{ef} | | | 1,5 h_{ef} | | |
| Spacing | $s_{cr,sp}$ | [mm] | | 4,0 h_{ef} | | | 3,0 h_{ef} | | |
| Partial safety factor | γ_{Msp} | [-] | | 1,8 | | | | | |

¹⁾ Design according EOTA Technical Report TR 055

²⁾ Design according EN 1992-4:2016

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Performances
Characteristic resistance for tension loads

Annex C 1

Table C2: Design method EN 1992-4
Characteristic values of resistance to shear load

| Steel failure without lever arm | | | | | | | | |
|--|---------------|------|-----------|------------|------------|------------|------------|------------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 |
| Steel grade 5.8 | $V_{Rk,s}$ | [kN] | 9 | 15 | 21 | 39 | 61 | 88 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | |
| Steel grade 8.8 | $V_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | |
| Steel grade 10.9 | $V_{Rk,s}$ | [kN] | 18 | 29 | 42 | 79 | 123 | 177 |
| Partial safety factor | γ_{Ms} | [-] | 1,5 | | | | | |
| Stainless steel grade A2-70, A4-70 | $V_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | |
| Stainless steel grade A4-80 | $V_{Rk,s}$ | [kN] | 15 | 23 | 34 | 63 | 98 | 141 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | |
| Stainless steel grade 1.4529 | $V_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | |
| Stainless steel grade 1.4565 | $V_{Rk,s}$ | [kN] | 13 | 20 | 30 | 55 | 86 | 124 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | |
| Characteristic resistance of group of fasteners | | | | | | | | |
| Ductility factor $k_7 = 1,0$ for steel with rupture elongation $A_5 > 8\%$ | | | | | | | | |

| Steel failure with lever arm | | | | | | | | |
|---|--------------------|-------|-----------|------------|------------|------------|------------|------------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 |
| Steel grade 5.8 | $M^{\circ}_{Rk,s}$ | [N.m] | 19 | 37 | 66 | 166 | 325 | 561 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | |
| Steel grade 8.8 | $M^{\circ}_{Rk,s}$ | [N.m] | 30 | 60 | 105 | 266 | 519 | 898 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | |
| Steel grade 10.9 | $M^{\circ}_{Rk,s}$ | [N.m] | 37 | 75 | 131 | 333 | 649 | 1123 |
| Partial safety factor | γ_{Ms} | [-] | 1,50 | | | | | |
| Stainless steel grade A2-70, A4-70 | $M^{\circ}_{Rk,s}$ | [N.m] | 26 | 52 | 92 | 233 | 454 | 786 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | |
| Stainless steel grade A4-80 | $M^{\circ}_{Rk,s}$ | [N.m] | 30 | 60 | 105 | 266 | 519 | 898 |
| Partial safety factor | γ_{Ms} | [-] | 1,33 | | | | | |
| Stainless steel grade 1.4529 | $M^{\circ}_{Rk,s}$ | [N.m] | 26 | 52 | 92 | 233 | 454 | 786 |
| Partial safety factor | γ_{Ms} | [-] | 1,25 | | | | | |
| Stainless steel grade 1.4565 | $M^{\circ}_{Rk,s}$ | [N.m] | 26 | 52 | 92 | 233 | 454 | 786 |
| Partial safety factor | γ_{Ms} | [-] | 1,56 | | | | | |
| Concrete pry-out failure | | | | | | | | |
| Factor for resistance to pry-out failure | k_8 | [-] | 2 | | | | | |

| Concrete edge failure | | | | | | | | |
|------------------------------|-----------|------|--------------------------------|------------|------------|------------|------------|------------|
| Size | | | M8 | M10 | M12 | M16 | M20 | M24 |
| Outside diameter of fastener | d_{nom} | [mm] | 8 | 10 | 12 | 16 | 20 | 24 |
| Effective length of fastener | l_f | [mm] | min (h_{ef} , 8 d_{nom}) | | | | | |

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Performances
Characteristic resistance for shear loads

Annex C 2

Table C3: Displacement under tension and shear load

| Anchor size | | | M8 | M10 | M12 | M16 | M20 | M24 |
|--------------|--------------------|------|-----|-----|------|------|------|------|
| Tension load | F | [kN] | 6,3 | 7,9 | 11,9 | 23,8 | 29,8 | 45,6 |
| Displacement | δ_{N0} | [mm] | 0,2 | 0,2 | 0,3 | 0,5 | 0,7 | 0,9 |
| | $\delta_{N\infty}$ | [mm] | 0,4 | 0,4 | 0,4 | 0,4 | 0,4 | 0,4 |
| Shear load | F | [kN] | 5,2 | 8,3 | 12,0 | 22,4 | 35,0 | 50,4 |
| Displacement | δ_{V0} | [mm] | 0,1 | 0,1 | 0,2 | 0,4 | 0,8 | 1,5 |
| | $\delta_{V\infty}$ | [mm] | 0,2 | 0,2 | 0,3 | 0,6 | 1,2 | 2,3 |

LUSAN POLIESTER SIN ESTIRENO
galvanized or stainless steel bonded anchor

Performances
Displacement

Annex C 3